

Perchlorate Sampling Locations Figure 2




Westford, Massachusetts - RTN 3-2628



C. Couto

NOTE:
* = "Nutting WTP Finished" represents blended water from the valley aquifer at its point of distribution into the public water supply.
** = A point-of-entry treatment system was installed at 97 Groton Road in May 2017 and at 99 Groton Road in November 2021.
*** = The Nutting Treatment Plant entered into seasonal bypass on November 7, 2016. The system went into indefinite bypass beginning on September 1, 2017.

	Groundwater		Parcels
	GW-Residential Well		Driveway
	GW_Spring		Buildings
	Surface Water		Marsh
	Valley Aquifer Portion of Site		Ponds
	Disposal Site Boundary		RiversStreams
	Highway Garage Parcel		10 FT Contour Lines

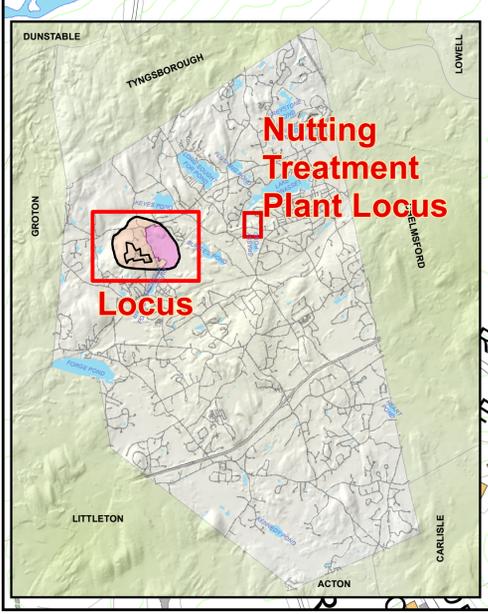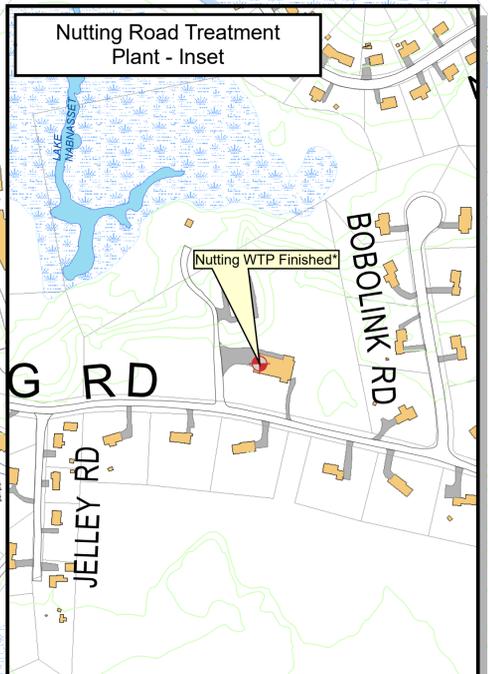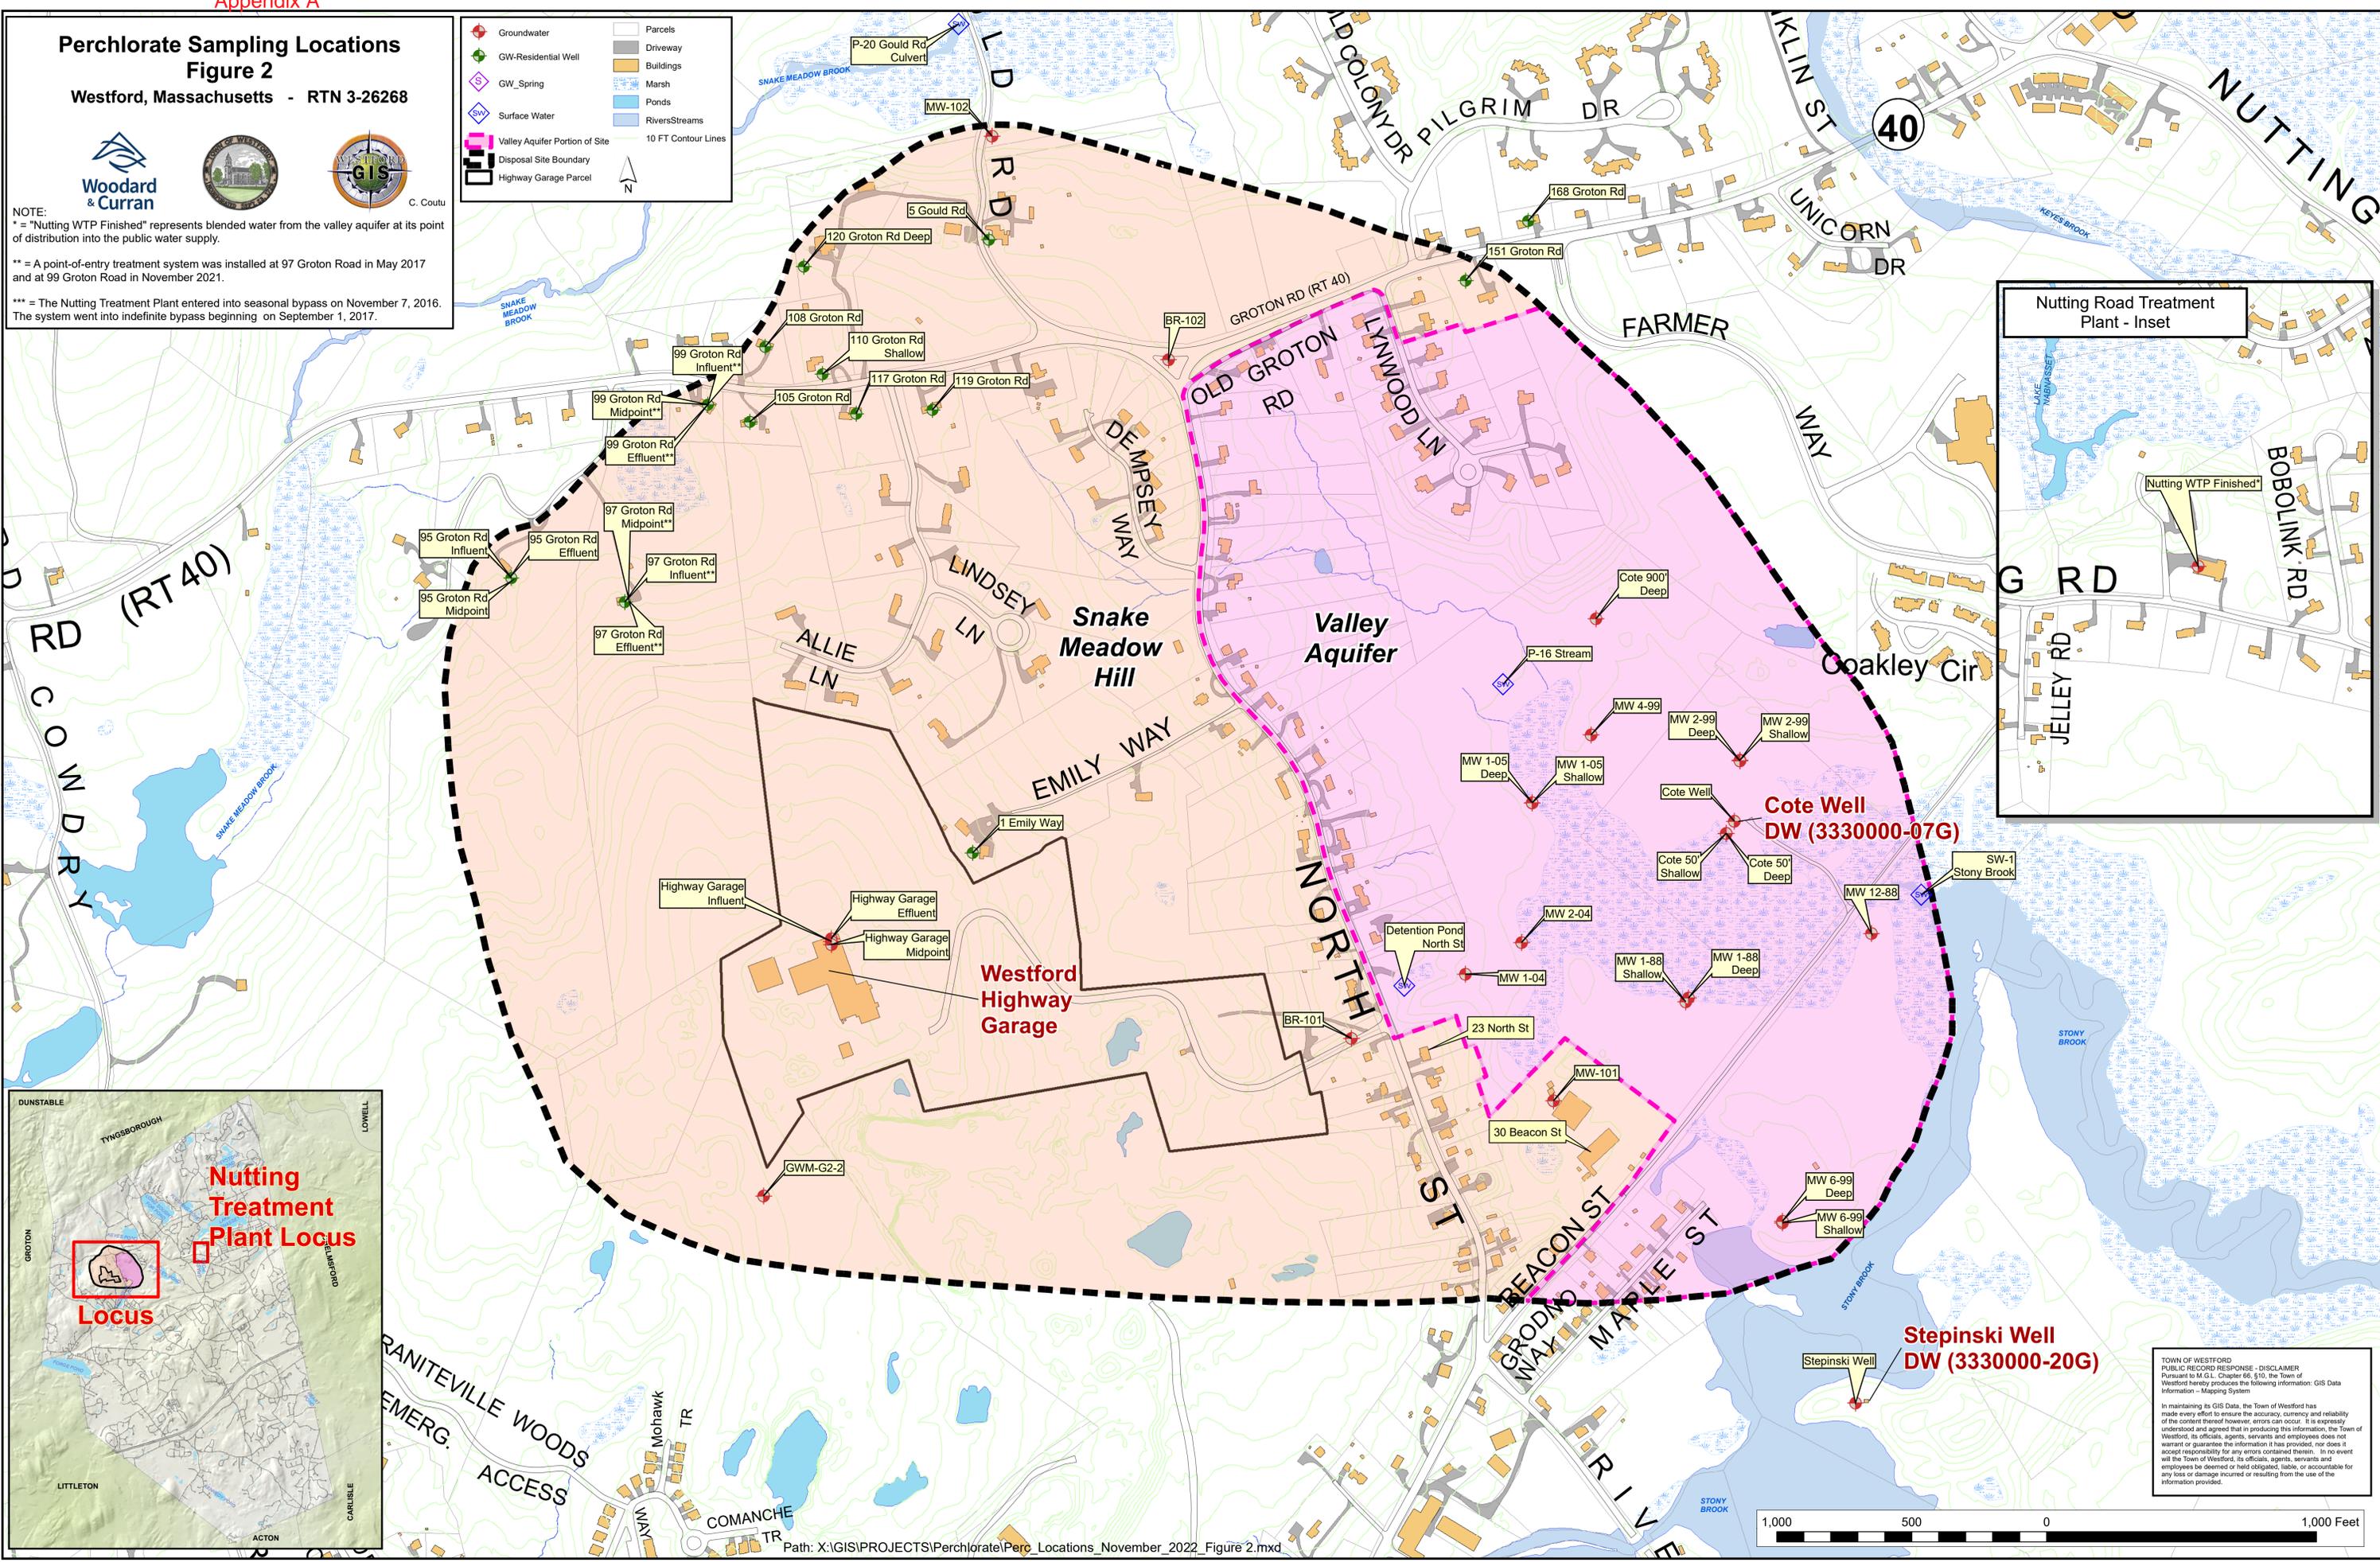

**TOWN OF WESTFORD
PUBLIC RECORD RESPONSE - DISCLAIMER**
Pursuant to M.G.L. Chapter 66, §10, the Town of Westford hereby produces the following information: GIS Data Information - Mapping System

In maintaining its GIS Data, the Town of Westford has made every effort to ensure the accuracy, currency and reliability of the content thereof however, errors can occur. It is expressly understood and agreed that in producing this information, the Town of Westford, its officials, agents, servants and employees does not warrant or guarantee the information it has provided, nor does it accept responsibility for any errors contained therein. In no event will the Town of Westford, its officials, agents, servants and employees be deemed or held obligated, liable, or accountable for any loss or damage incurred or resulting from the use of the information provided.

